Unit 25 / 205-213
Port Hacking Rd
Miranda, NSW, 2228
AUSTRALIA
T: +61 2 9522 0334
F: +61 2 9522 0337
www.mjbcontrols.com.au

DRAWN BY	Michael Bussani
DATE	25 July 2010
REVISION	A
SCALE	N.T.S.

Electrical Schematic

ACCS-1 Residential Air Cooled Control System
with Zone Control
Sheet 1 of 1

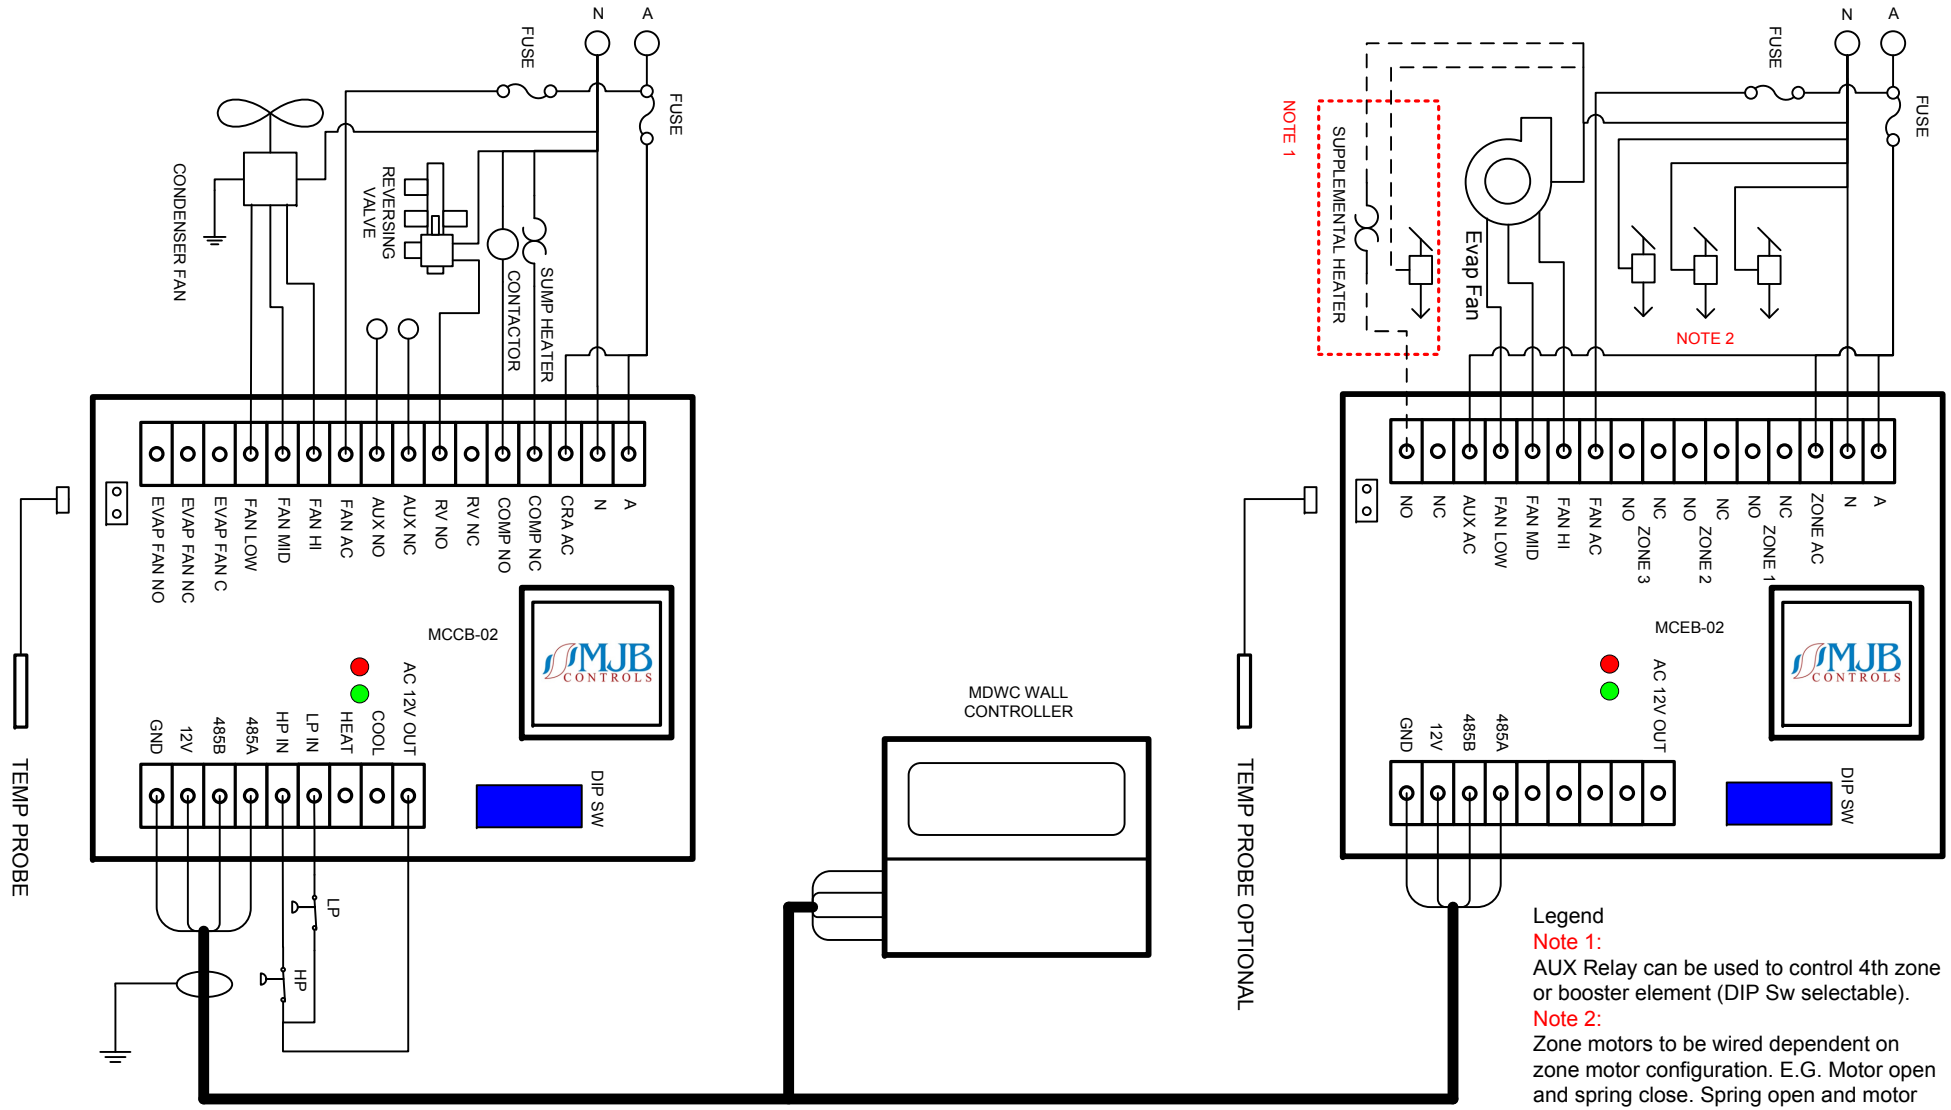

Legend

Note 1:
AUX Relay can be used to control 4th zone or booster element (DIP Sw selectable).

Note 2:
Zone motors to be wired dependent on zone motor configuration. E.G. Motor open and spring close. Spring open and motor close. Motor open and motor close.

Copyright © 2010 MJB Controls Pty Ltd. MJB Controls reserve the right to make alterations to this specification without written permission or notice.